



NINGBO YOSUN ELECTRIC TECHNOLOGY CO., LTD

CE EMC REPORT

Prepared For :	NINGBO YOSUN ELECTRIC TECHNOLOGY CO., LTD Room 906,Rooms (9-1), (9-2), Langmu Building, Baisha Road Sub District, Cixi City, Ningbo, China
Product Name:	POWER DISTRIBUTION UNIT(PDU)
Trade Name:	NB YOSUN
Model :	YS110163-KGS, YS110X3-KGS-MS, YS115X3-KGS-MS, YS120X3-KGS-MS, YS310X3-KGS-MS, YS315X3-KGS-MS, YS320X3-KGS-MS, X: number of sockets: 1~50 K: Switch G: Overload protection S: Surge protection M: Monitoring S: Switching
Prepared By :	BST Testing (Shenzhen) Co.,Ltd. No.7, New Era Industrial Zone, Guantian, Bao'an District, Shenzhen, Guangdong, China
Test Date:	Oct.25, 2023-Oct. 30, 2023
Date of Report	Oct. 30, 2023
Report No.:	XDD30231411103001ER



TABLE OF CONTENTS

TEST REPORT DECLARATION.....	5
1) TEST RESULTS SUMMARY.....	6
2) GENERAL INFORMATION.....	7
• Report information.....	7
• Measurement Uncertainty.....	7
3) PRODUCT DESCRIPTION.....	8
• EUT Description.....	8
• Block Diagram of EUT Configuration.....	8
• Operating Condition of EUT.....	8
• Test Conditions.....	8
• Modifications.....	8
• Abbreviations.....	9
• Performance Criterion.....	9
4) TEST EQUIPMENT USED.....	10
• For Conducted Emission Test.....	10
• For Radiated Emission Measurement.....	10
• For Harmonic / Flicker Test.....	10
• For Electrostatic Discharge Immunity Test.....	10
• For RF Strength Susceptibility Test.....	10
• For Electrical Fast Transient/Burst Immunity Test.....	11
• For Surge Test.....	11
• For Injected Currents Susceptibility Test.....	11
• For Magnetic Field Immunity Test.....	11
• For Voltage Dips and Interruptions Test.....	11
5) POWER LINE CONDUCTED EMISSION TEST.....	12
• Block Diagram of Test Setup.....	12
• Test Standard.....	12
• Power Line Conducted Emission Limit.....	12
• EUT Configuration on Test.....	12
• Operating Condition of EUT.....	13
• Test Procedure.....	13
• Test Result.....	13
6) RADIATED EMISSION TEST.....	14
• Semi-Anechoic Chamber Setup Diagram.....	14
• Test Standard.....	14
• Radiated Emission Limit.....	14
• EUT Configuration on Test.....	14
• Operating Condition of EUT.....	15
• Test Procedure.....	15
• Test Results.....	15
7) HARMONIC CURRENT EMISSION TEST.....	16
• Block Diagram of Test Setup.....	16



•	Test Standard and Limit.....	16
•	Test Procedure.....	17
•	Test Results.....	17
8)	VOLTAGE FLUCTUATIONS & FLICKER TEST.....	18
•	Block Diagram of Test Setup.....	18
•	Test Standard.....	18
•	Operating Condition of EUT.....	18
•	Test Data.....	18
•	Test Results.....	18
9)	ELECTROSTATIC DISCHARGE TEST.....	19
•	Block Diagram of ESD Test Setup.....	19
•	Test Standard.....	19
•	Severity Levels and Performance Criterion.....	19
•	EUT Configuration on Test.....	19
•	Operating Condition of EUT.....	19
•	Test Procedure.....	20
•	Test Results.....	20
10)	RF FIELD STRENGTH SUSCEPTIBILITY TEST.....	22
•	R/S Test Setup.....	22
•	Test Standard.....	22
•	Severity Levels and Performance Criterion.....	22
•	EUT Configuration on Test.....	23
•	Operating Condition of EUT.....	23
•	Test Procedure.....	23
•	Test Results.....	23
11)	ELECTRICAL FAST TRANSIENT/BURST TEST.....	25
•	EFT Test Setup.....	25
•	Test Standard.....	25
•	Severity Levels and Performance Criterion.....	25
•	EUT Configuration on Test.....	25
•	Operating Condition of EUT.....	25
•	Test Procedure.....	26
•	Test Results.....	26
12)	SURGE TEST.....	28
•	Surge Test Setup.....	28
•	Test Standard.....	28
•	Severity Levels and Performance Criterion.....	28
•	EUT Configuration on Test.....	28
•	Operating Condition of EUT.....	28
•	Test Procedure.....	29
•	Test Results.....	29
13)	INJECTED CURRENTS SUSCEPTIBILITY TEST.....	31
•	Block Diagram of Test AC Mains Setup.....	31
•	Test Standard.....	31
•	Severity Levels and Performance Criterion.....	31
•	EUT Configuration on Test.....	31
•	Operating Condition of EUT.....	31
•	Test Procedure.....	32



• Test Results.....	32
14) VOLTAGE DIPS AND INTERRUPTIONS TEST.....	34
• Voltage Dips and Interruptions Test Setup.....	34
• Test Standard.....	34
• Severity Levels and Performance Criterion.....	34
• EUT Configuration on Test.....	34
• Operating Condition of EUT.....	34
• Test Procedure.....	35
• Test Result.....	35
APPENDIX I.....	37
APPENDIX II.....	40
APPENDIX III.....	43



TEST REPORT DECLARATION

Applicant	:	NINGBO YOSUN ELECTRIC TECHNOLOGY CO., LTD
Address	:	Room 906,Rooms (9-1), (9-2), Langmu Building, Baisha Road Sub District, Cixi City, Ningbo, China
EUT Description	:	POWER DISTRIBUTION UNIT(PDU)
Model Number	:	YS110163-KGS, YS110X3-KGS-MS, YS115X3-KGS-MS, YS120X3-KGS-MS, YS310X3-KGS-MS, YS315X3-KGS-MS, YS320X3-KGS-MS, X: number of sockets: 1~50 K: Switch G: Overload protection S: Surge protection M: Monitoring S: Switching



Test Standards:

EN 55032:2015+A11:2020

EN IEC 61000-3-2:2019/A1:2021

EN 61000-3-3:2013+A2:2021+AC:2022-01

EN 55035:2017/A11:2020

The EUT described above is tested by BST Testing (Shenzhen) Co.,Ltd. EMC Laboratory to determine the maximum emissions from the EUT and ensure the EUT to be compliance with the immunity requirements of the EUT. BST Testing (Shenzhen) Co.,Ltd. EMC Laboratory is assumed full responsibility for the accuracy of the test results. Also, this report shows that the EUT technically complies with the 2014/30/EU directive and its amendment requirements.

The test report is valid for above tested sample only and shall not be reproduced in part without written approval of the laboratory.

Prepared by :

Ivy Zhong

Assistant

Tested by :

Toby Zhong

Test Engineer

Reviewer :

Tom chen

Supervisor

Approved & Authorized Signer :



Salon/Manager



1) TEST RESULTS SUMMARY

Table 1 Test Results Summary

Test Items	Test Results
Power Line Conducted Emission Test	PASS
Radiated Emission Test	PASS
Harmonic Current Emission Test	PASS
Voltage Fluctuations & Flicker Test	PASS
Electrostatic Discharge Test	PASS
RF Field Strength Susceptibility Test	PASS
Electrical Fast Transient/Burst Test	PASS
Surge Test	PASS
Injected Currents Susceptibility Test	PASS
Voltage Dips And Interruptions Test	PASS



2) GENERAL INFORMATION

- Report information
 - This report is not a certificate of quality; it only applies to the sample of the specific product/equipment given at the time of its testing. The results are not used to indicate or imply that they are application to the similar items. In addition, such results must not be used to indicate or imply that BST approves recommends or endorses the manufacture, supplier or use of such product/equipment, or that BST in any way guarantees the later performance of the product/equipment.
 - The sample/s mentioned in this report is/are supplied by Applicant, BST therefore assumes no responsibility for the accuracy of information on the brand name, model number, origin of manufacture or any information supplied.
 - Additional copies of the report are available to the Applicant at an additional fee. No third part can obtain a copy of this report through BST, unless the applicant has authorized BST in writing to do so.
- Measurement Uncertainty

(95% confidence levels, $k=2$)

Test Item	Uncertainty
Uncertainty for Conduction emission test	2.2dB
Uncertainty for Radiation emission test (30MHz to 1GHz)	4.0dB




3) **PRODUCT DESCRIPTION**

- EUT Description

Description	:	POWER DISTRIBUTION UNIT(PDU)
Applicant	:	NINGBO YOSUN ELECTRIC TECHNOLOGY CO., LTD Room 906,Rooms (9-1), (9-2), Langmu Building, Baisha Road Sub District, Cixi City, Ningbo, China
Manufacturer	:	NINGBO YOSUN ELECTRIC TECHNOLOGY CO., LTD Room 906,Rooms (9-1), (9-2), Langmu Building, Baisha Road Sub District, Cixi City, Ningbo, China
Model Number	:	YS110163-KGS

- Block Diagram of EUT Configuration



- Operating Condition of EUT

Test mode 1: ON

- Test Conditions

Temperature: 23-26 °C

Relative Humidity: 55-68 %

- Modifications

No modification was made.



- Abbreviations

AC	Alternating Current
AMN	Artificial Mains Network
DC	Direct Current
EM	ElectroMagnetic
EMC	ElectroMagnetic Compatibility
EUT	Equipment Under Test
IF	Intermediate Frequency
RF	Radio Frequency
rms	root mean square
EMI	Electromagnetic Interference
EMS	Electromagnetic Susceptibility

- Performance Criterion

Criterion A: The equipment shall continue to operate as intended without operator intervention. No degradation of performance or loss of function is allowed below a performance level specified by the manufacturer when the equipment is used as intended.

Criterion B: After the test, the equipment shall continue to operate as intended without operator intervention. No degradation of performance or loss of function is allowed, after the application of the phenomena below a performance level specified by the manufacturer, when the equipment is used as intended.

Criterion C: Loss of function is allowed, provided the function is self-recoverable, or can be restored by the operation of the controls by the user in accordance with the manufacturer's instructions.



4) TEST EQUIPMENT USED

- For Conducted Emission Test

Ite	Equipment	Manufacturer	Model No.	Serial No.	Last Cal.	Cal. Interval
1.	Test Receiver	Rohde & Schwarz	ESHS30	828985/018	May 23,23	1 Year
2.	Pulse Limiter	Rohde & Schwarz	ESH3-Z2	100006	May 23,23	1 Year
3.	L.I.S.N.	Rohde & Schwarz	ESH2-Z5	834549/005	May 23,23	1 Year
4.	Conical	Emtek	N/A	N/A	N/A	N/A
5.	Voltage Probe	Schwarzbeck	TK9416	N/A	May 23,23	1 Year
6.	Coaxial Switch	Anritsu	MP59B	6100214550	May 23,23	1 Year

- For Radiated Emission Measurement

Ite	Equipment	Manufacturer	Model No.	Serial	Last Cal.	Cal.
1.	Spectrum Analyzer	ANRITSU	MS2661C	620014091	May 23,23	1 Year
2.	Test Receiver	Rohde&Schwarz	ESC830	828982/018	May 23,23	1 Year
3.	Bilog Antenna	Schwarzbeck	VULB9163	142	May 23,23	1 Year
4.	50 Coaxial Switch	Anritsu Corp	MP59B	610023724	May 23,23	1 Year
5.	Cable	Schwarzbeck	AK9513	ACRX1	May 23,23	1 Year
6.	Cable	Rosenberger	N/A	FR2RX2	May 23,23	1 Year
7.	Cable	Schwarzbeck	AK9513	CRRX2	May 23,23	1 Year
8.	Cable	Schwarzbeck	AK9513	CRRX2	May 23,23	1 Year
9.	Signal Generator	HP	864A	3625U0057	May 23,23	1 Year

- For Harmonic / Flicker Test

Ite	Equipment	Manufacturer	Model No.	Serial No.	Last Cal.	Cal. Interval
1.	Harmonic and Flicker analyzer	Laplace	AC2000A	309709	May 23,23	1 Year

- For Electrostatic Discharge Immunity Test

Ite	Equipment	Manufacturer	Model No.	Serial No.	Last Cal.	Cal. Interval
1.	ESD Tester	HAEFELY	PSD 1600	H911'292	May 23,23	1 Year

- For RF Strength Susceptibility Test

Ite	Equipment	Manufacturer	Model No.	Serial No.	Last Cal.	Cal. Interval
1.	Signal Generator	HP	8648A	3633A0208	May	1 Year
2.	Amplifier	A&R	500A100	17034	NCR	NCR
3.	Amplifier	A&R	100W/1000M1	17028	NCR	NCR
4.	Isotropic Field Monitor	A&R	FM2000	16829	NCR	NCR
5.	Isotropic Field Probe	A&R	FLW220100	16755	May	1 Year
6.	Biconic Antenna	EMCO	3108	9507-2534	NCR	NCR
7.	Log-periodic Antenna	A&R	AT1080	16812	NCR	NCR
8.	PC	N/A	486DX2	N/A	N/A	N/A



- For Electrical Fast Transient/Burst Immunity Test

Ite	Equipment	Manufacturer	Model No.	Serial No.	Last Cal.	Cal. Interval
1.	Burst Tester	HAEFELY	PEFT 4010	080981-16	May	1 Year

- For Surge Test

Ite	Equipment	Manufacture	Model No.	Serial	Last Cal.	Cal.
1.	Surge Tester	HAEFELY	PSURGE4.1	080107-04	May 23,23	1 Year

- For Injected Currents Susceptibility Test

Ite	Equipment	Manufactur	Model No.	Serial No.	Last	Cal.
1.	Simulator	EMTEST	CWS 500C	0900-12	May 23,23	1 Year
2.	CDN	EMTEST	CDN-M2	510010010010	May 23,23	1 Year
3.	VDN	EMTEST	CDN-M3	0900-11	May 23,23	1 Year
4.	Injection Clamp	EMTEST	F-2031-23MM	368	May 23,23	1 Year
5.	Attenuator	EMTEST	ATT6	0010222a	May 23,23	1 Year

- For Magnetic Field Immunity Test

Ite	Equipment	Manufacture	Model No.	Serial	Last Cal.	Cal.
1.	Magnetic Field Tester	HEAFELY	MAG100.1	083858-	May 23,23	1 Year


- For Voltage Dips and Interruptions Test

Ite	Equipment	Manufacture	Model No.	Serial	Last Cal.	Cal.
1.	Dips Tester	HEAFELY	PLINE 1610	083732-	May 23,23	1 Year



5) POWER LINE CONDUCTED EMISSION TEST

- Block Diagram of Test Setup

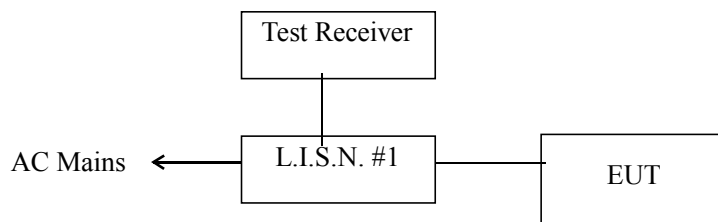

- Test Standard

EN 55032:2015+A11:2020

- Power Line Conducted Emission Limit

Frequency	Limits dB(μV)	
	Quasi-peak Level	Average Level
0.15 ~ 0.50	66 ~ 56*	56 ~ 46*
0.50 ~ 5.00	56	46
5.00 ~ 30.00	60	50

Notes: 1. *Decreasing linearly with logarithm of frequency.

2. The lower limit shall apply at the transition frequencies.

- EUT Configuration on Test

The following equipments are installed on conducted emission test to meet EN55032 requirement and operating in a manner, which tends to maximize its emission characteristics in a normal application.

- EUT Information

Model Number : YS110163-KGS
Serial Number : N/A
Manufacturer : NINGBO YOSUN ELECTRIC TECHNOLOGY CO., LTD



- Operating Condition of EUT

- Setup the EUT and simulators as shown in Section 5.1.

5.5.2.Turn on the power of all equipments.

5.5.3.Let the EUT work in test modes (ON) and test it.

- Test Procedure

The EUT is put on the ground and connected to the AC mains through a Artificial Mains Network (AMN). This provided 50ohm-coupling impedance for the tested equipments. Both sides of AC line are checked to find out the maximum conducted emission levels according to the EN55032 regulations during conducted emission test.

The bandwidth of the test receiver is set at 9kHz.

The frequency range from 150 KHz to 30 MHz is investigated. and all the scanning waveform is put in **Appendix I**.


- Test Result

PASS.



6) RADIATED EMISSION TEST

- Semi-Anechoic Chamber Setup Diagram

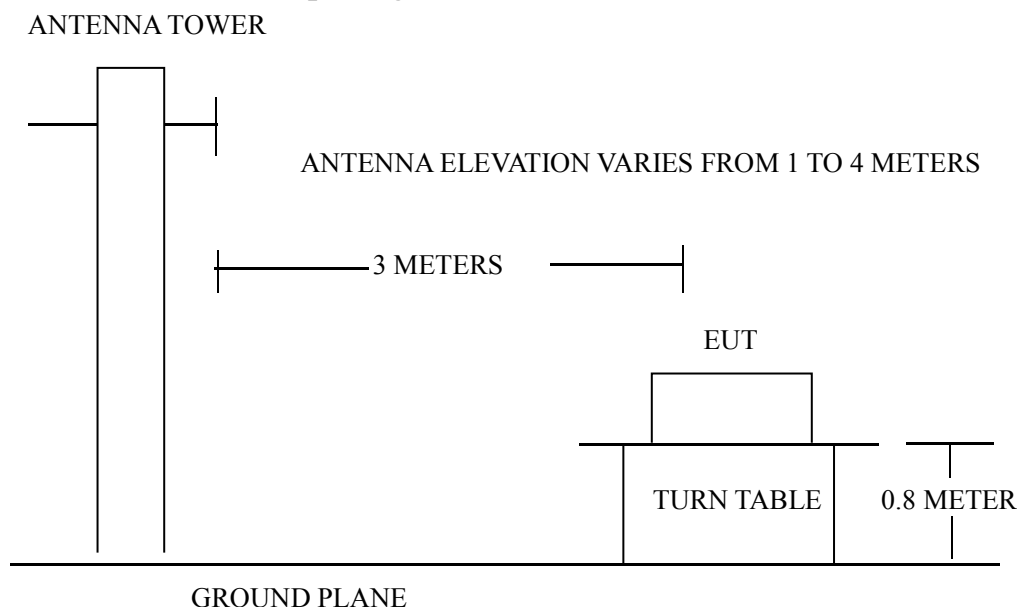

- Test Standard
EN 55032:2015+A11:2020
- Radiated Emission Limit

All emanations from a Class B computing devices or system, including any network of conductors and apparatus connected thereto, shall not exceed the level of field strengths specified below:

FREQUENCY	DISTANCE (Meters)	FIELD STRENGTHS LIMITS (dB μ V/m)
30 ~ 230	3	40
230 ~ 1000	3	47

Note: (1) The tighter limit shall apply at the edge between two frequency bands.

(2) Distance refers to the distance in meters between the measuring instruments antenna and the closed point of any part of the EUT.

- EUT Configuration on Test

The EN55032 Class B regulations test method must be used to find the maximum emission during radiated emission test.



- Operating Condition of EUT

- Setup the EUT as shown on Section 6.1.

6.5.2.Turn on the power of all equipments.

6.5.3.Let the EUT work in test mode (ON) and measure it.

- Test Procedure

The EUT is placed on a turn table which is 0.8 meter above ground. The turn table can rotate 360 degrees to determine the position of the maximum emission level. The EUT is set 3 meters away from the receiving antenna which is mounted on a antenna tower. The antenna can move up and down between 1 to 4 meters to find out the maximum emission level. Broadband antenna (calibrated by dipole antenna) are used as a receiving antenna. Both horizontal and vertical polarization of the antenna are set on test.

The bandwidth setting on the test receiver is 120 KHz.

The EUT is tested in Semi-Anechoic Chamber. and all the scanning waveform is put in **Appendix II.**


- Test Results

PASS.



7) HARMONIC CURRENT EMISSION TEST

- Block Diagram of Test Setup

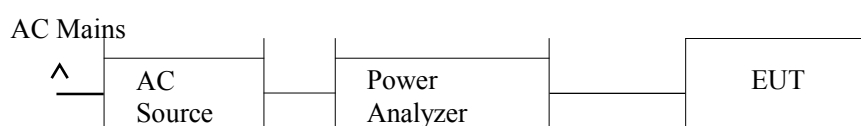

- Test Standard and Limit

- Test Standard

EN IEC 61000-3-2:2019+A1:2021

7.2.2.Limits

Table 12 Harmonic Current Test Limit (Class A)

Harmonic order (n)	Maximum permissible harmonic current (A)
Odd harmonics	
3	2.30
5	1.14
7	0.77
9	0.40
11	0.33
13	0.21
15≤n≤39	0.15×15/n
Even harmonics	
2	1.08
4	0.43
6	0.30
8≤n≤40	0.23×8/n



- **Test Procedure**

The power cord of the EUT is connected to the output of the test system. Turn on the Power of the EUT and use the test system to test the harmonic current level.

- **Test Results**

PASS.



8) VOLTAGE FLUCTUATIONS & FLICKER TEST

- Block Diagram of Test Setup

Same as Section 7.1..

- Test Standard

EN 61000-3-3:2013+A2:2021+AC:2022-01

- Operating Condition of EUT

Same as Section 7.3.. The power cord of the EUT is connected to the output of the test system. Turn on the power of the EUT and use the test system to test.

Flicker Test Limit

Test items	Limits
Pst	1.0
dc	3.3%
dmax	4.0%
dt	Not exceed 3.3% for 500ms

- Test Data

Flicker test Data

Model No.: YS110163-KGS

Test Mode: 1


Items	Reading	Limit
dmax	0.02	4.0%
dc	0.03	3.3%
dt	0.05	Not exceed 3.3% for
Pst	0.001	1.0

- Test Results

PASS.

9) ELECTROSTATIC DISCHARGE TEST

- Block Diagram of ESD Test Setup

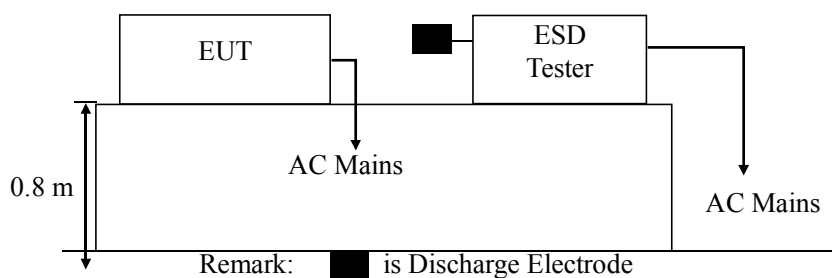

- Test Standard
EN 55035:2017/A11:2020 (EN 61000-4-2:2009)
Severity Level 3 for Air Discharge at 8KV
Severity Level 2 for Contact Discharge at 4KV
- Severity Levels and Performance Criterion

- Severity level

Level	Test Voltage Contact Discharge	Test Voltage Air Discharge
1.	2	2
2.	4	4
3.	6	8
4.	8	15
X.	Special	Special

- Performance criterion: B
- EUT Configuration on Test
The configuration of EUT are listed in Section 3.2.
- Operating Condition of EUT
 - Setup the EUT as shown in Section 9.1.
 - 9.5.2. Turn on the power of all equipments.
 - 9.5.3. Let the EUT work in test mode (On) and test it.



- Test Procedure

- Air Discharge:

This test is done on a non-conductive surfaces. The round discharge tip of the discharge electrode shall be approached as fast as possible to touch the EUT.

After each discharge, the discharge electrode shall be removed from the EUT.

The generator is then re-triggered for a new single discharge and repeated 10 times for each pre-selected test point. This procedure shall be repeated until all the air discharge completed.

- Contact Discharge:

All the procedure shall be same as Section 9.6.1. except that the tip of the discharge electrode shall touch the EUT before the discharge switch is operated.

- Indirect discharge for horizontal coupling plane

At least 20 single discharges shall be applied to the horizontal coupling plane, at points on each side of the EUT. The discharge electrode positions vertically at a distance of 0.1m from the EUT and with the discharge electrode touching the coupling plane.

- Indirect discharge for vertical coupling plane

At least 20 single discharge shall be applied to the center of one vertical edge of the coupling plane. The coupling plane, of dimensions 0.5m X 0.5m, is placed parallel to, and positioned at a distance of 0.1m from the EUT. Discharges shall be applied to the coupling plane, with this plane in sufficient different positions that the four faces of the EUT are completely illuminated.

- Test Results

PASS.

Please refer to the following page.



Electrostatic Discharge Test Results

BST Testing (Shenzhen) Co., Ltd.


Applicant	: NINGBO YOSUN ELECTRIC TECHNOLOGY CO., LTD	Test Date	: Oct. 30, 2023
EUT	: POWER DISTRIBUTION UNIT(PDU)	Temperature	: 22 °C
M/N	: YS110163-KGS	Humidity	: 50 %
POWER DISTRIBUTION UNIT(PDU)	: 400V/230V~, 50/60Hz	Test Mode	: on
Air Discharge: $\pm 8KV$ For each point positive 10 times and negative 10 times discharge. Contact Discharge: $\pm 4KV$			
Location	Kind A-Air Discharge C-Contact Discharge		Result
Slots	A		PASS
Metal Parts	C		PASS
HCP	C		PASS
VCP	C		PASS

Discharge should be considered on Contact and Air and Horizontal Coupling Plane (HCP) and Vertical Coupling Plane (VCP).



10) RF FIELD STRENGTH SUSCEPTIBILITY TEST

- R/S Test Setup

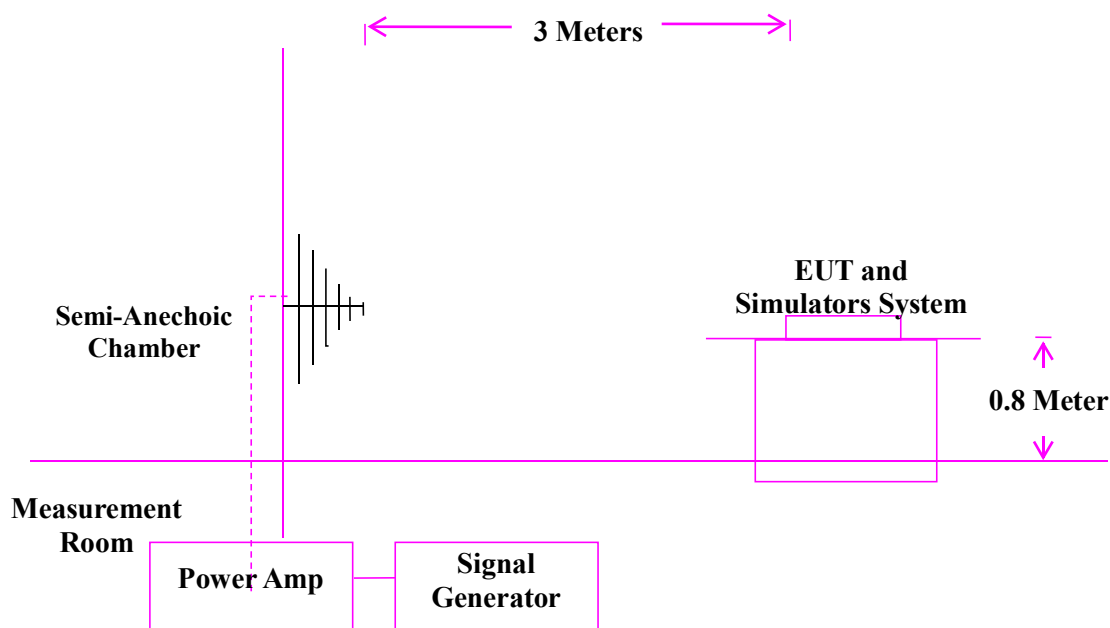

- Test Standard

EN 55035:2017/A11:2020 (EN 61000-4-3:2006 + A1:2008 + A2:2010)
Severity Level 2 at 3V / m

- Severity Levels and Performance Criterion

- Severity level

Level	Field Strength V/m
1.	1
2.	3
3.	10
X.	Special

- Performance criterion : A



- EUT Configuration on Test

The configuration of EUT are listed in Section 3.2

- Operating Condition of EUT

Setup the EUT as shown in Section 10.1.. The operating condition of EUT are listed in section 3.3.

- Test Procedure

The EUT and its simulators are placed on a turn table which is 0.8 meter above the ground. The EUT is set 3 meters away from the transmitting antenna which is mounted on an antenna tower. Both horizontal and vertical polarization of the antenna are set on test. Each of the four sides of EUT must be faced this transmitting antenna and measured individually. In order to judge the EUT performance, a CCD camera is used to monitor the EUT. All the scanning conditions are as follows :

Condition of Test		Remarks
1	Fielded Strength	3 V/m (Severity Level 2)
2	Radiated Signal	Modulated
3	Scanning Frequency	80 - 1000 MHz, 1.4GHz-
4	Sweeping time of radiated	0.0015 decade/s
5	Dwell Time	1 Sec.

- Test Results

PASS.

Please refer to the following page.




RF Field Strength Susceptibility Test Results

BST Testing (Shenzhen) Co.,Ltd.

Applicant	: NINGBO YOSUN ELECTRIC TECHNOLOGY CO., LTD	Test Date	: Oct. 30, 2023
EUT	: POWER DISTRIBUTION UNIT(PDU)	Temperature	: 22 °C
M/N	: YSI10163-KGS	Humidity	: 50
POWER DISTRIBUTION UNIT(PDU)	: 400V/230V~, 50/60Hz	Test Mode	: %
Frequency	: 80 MHz to 1000 MHz, 1.4GHz-2.7GHz		
Modulation:	☒ AM ☐ Pulse ☐ none	1 KHz	80%
Criterion :	A		
	Frequency Rang :	80-1000MHZ, 1.4GHz-2.7GHz	
Steps	1%	1%	
	Horizontal	Vertical	
Front	Pass	Pass	
Right	Pass	Pass	
Rear	Pass	Pass	
Left	Pass	Pass	

11) ELECTRICAL FAST TRANSIENT/BURST TEST

- EFT Test Setup

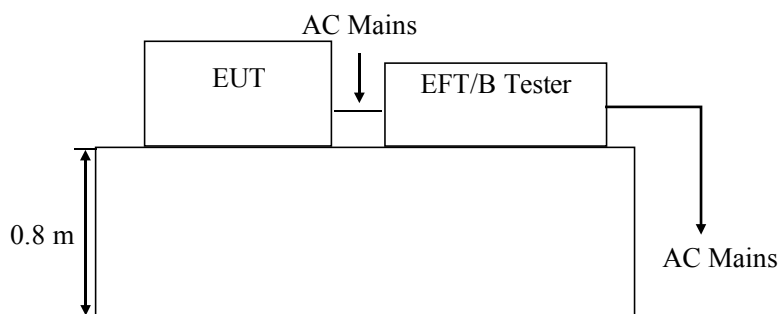

- Test Standard

EN 55035:2017/A11:2020 (EN 61000-4-4:2012)
Severity Level 2 at 1KV

- Severity Levels and Performance Criterion

- Severity level

Open Circuit Output Test Voltage $\pm 10\%$		
Level	On POWER DISTRIBUTION	On I/O (Input/Output) Signal data and control
1.	0.5 KV	0.25 KV
2.	1 KV	0.5 KV
3.	2 KV	1 KV
4.	4 KV	2 KV
X	Special	Special

- Performance criterion : B

- EUT Configuration on Test

The configuration of EUT are listed in Section 3.2..

- Operating Condition of EUT

Setup the EUT as shown in Section 11.1.. The operating condition of EUT are listed in section 3.3.



- Test Procedure

The EUT is put on the table which is 0.8 meter high above the ground. This reference ground plane shall project beyond the EUT by at least 0.1m on all sides and the minimum distance between the EUT and all other conductive structure, except the ground plane beneath the EUT, shall be more than 0.5m.

- For input and output AC power ports:

The EUT is connected to the power mains by using a coupling device which couples the EFT interference signal to AC power lines. Both polarities of the test voltage should be applied during compliance test and the duration of the test is 2 mins.

- For signal lines and control lines ports:

It's unnecessary to test.

- For DC output line ports:

It's unnecessary to test.

- Test Results

PASS.

Please refer to the following page.




Electrical Fast Transient/Burst Test Results

BST Testing (Shenzhen) Co., Ltd.

Applicant		NINGBO YOSUN ELECTRIC TECHNOLOGY CO., LTD			Test Date		:	Oct. 30, 2023	
EUT		POWER DISTRIBUTION UNIT(PDU)			Temperature		:	22 ℃	
M/N		YS110163-KGS			Humidity		:	50 %	
POWER DISTRIBUTIO		400V/230V~, 50/60Hz			Test Mode		:	on	
Inject Place : AC Mains									
Inject Line	Volt ag	Inje ct	Inje ct	Results	Inject Line	Volt ag	Inje ct	Inje ct	Resul ts
L	±1	120	Direct	PASS					
N	±1	120	Direct	PASS					
L N	±1	120	Direct	PASS					

12) SURGE TEST

- Surge Test Setup

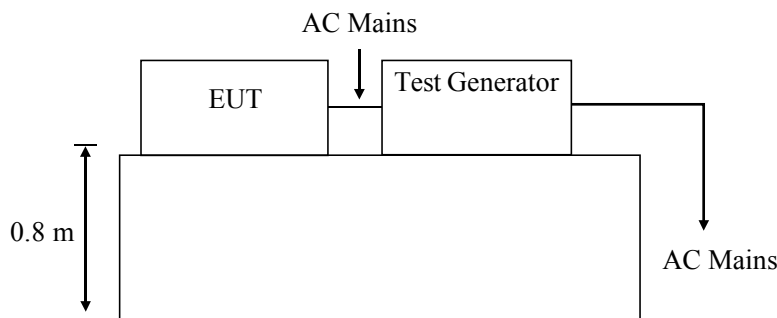

- Test Standard

EN 55035:2017/A11:2020 (EN 61000-4-5:2014)
Severity Level 2 for Line to Neutral at 1.0KV

- Severity Levels and Performance Criterion

- Severity level

Severity Level	Open-Circuit Test Voltage KV
1	0.5
2	1.0
3	2.0
4	4.0
*	Special

Performance criterion : **B**

- EUT Configuration on Test

The configuration of EUT are listed in Section 3.2.

- Operating Condition of EUT

- Setup the EUT as shown in Section 12.1..

12.5.2. Turn on the power of all equipments.

12.5.3. Let the EUT work in test mode (On) and test it.



- Test Procedure

- 1) Setup the EUT and test generator as shown on Section 12.1.
- 2) For line to line coupling mode, provide a 1.0KV 1.2/50us voltage surge (at open-circuit condition) and 8/20us current surge to EUT selected points.
- 3) At least 5 positive and 5 negative (polarity) tests with a maximum 1/min repetition rate are conducted during test.
- 4) Different phase angles are done individually.
- 5) Record the EUT operating situation during compliance test and decide the EUT immunity criterion for above each test.

- Test Results

PASS.

Please refer to the following page.




Surge Immunity Test Results

BST Testing (Shenzhen) Co., Ltd.

<i>Applicant</i> : NINGBO YOSUN ELECTRIC TECHNOLOGY CO., LTD				<i>Test Date</i> :	Oct. 30, 2023
<i>EUT</i> : POWER DISTRIBUTION UNIT(PDU)				<i>Temperature</i> :	22 °C
<i>M/N</i> : YS110163-KGS				<i>Humidity</i> :	50 %
<i>POWER DISTRIBUTION UNIT(PDU)</i> : 400V/230V~, 50/60Hz				<i>Test Mode</i> :	on
<i>Location</i>	<i>Polarity</i>	<i>Phase</i>	<i>No of Pulse</i>	<i>Pulse Voltage (KV)</i>	<i>Result</i>
L-N	+	0	5	1.0	PASS
	+	90	5	1.0	PASS
	+	180	5	1.0	PASS
	+	270	5	1.0	PASS
	-	0	5	1.0	PASS
	-	90	5	1.0	PASS
	-	180	5	1.0	PASS
	-	270	5	1.0	PASS

13) INJECTED CURRENTS SUSCEPTIBILITY TEST

- Block Diagram of Test AC Mains Setup

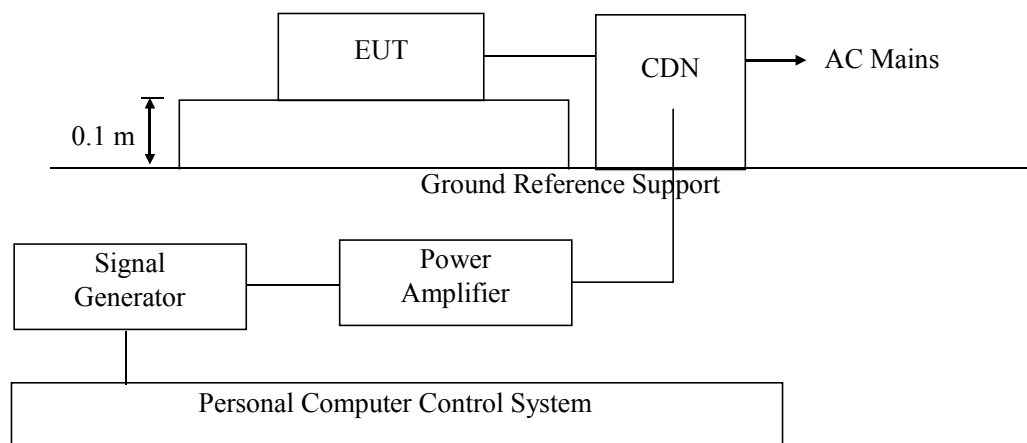

- Test Standard

EN 55035:2017/A11:2020 (EN 61000-4-6:2014)
Severity Level 2 at 3 V (rms), 0.15MHz ~ 80MHz

- Severity Levels and Performance Criterion

- Severity level

Level	Field Strength V/m
1.	1
2.	3
3.	10
X	Special

- Performance criterion: A
- EUT Configuration on Test

The configuration of EUT are listed in Section 3.2

- Operating Condition of EUT

Setup the EUT as shown in Section 13.1.. The operating condition of EUT are listed in section 3.3



- Test Procedure

1. Set up the EUT, CDN and test generators as shown on Section 13.1.
2. Let the EUT work in test mode and test it.
3. The EUT are placed on an insulating support 0.8m high above a ground reference plane. CDN (coupling and decoupling device) is placed on the ground plane about 0.3m from EUT. Cables between CDN and EUT are as short as possible, and their height above the ground reference plane shall be between 30 and 50 mm (where possible).
4. The disturbance signal described below is injected to EUT through CDN.
5. The EUT operates within its operational mode(s) under intended climatic conditions after power on.
6. The frequency range is swept from 150KHz to 80MHz using 3V signal level, and with the disturbance signal 80% amplitude modulated with a 1KHz sine wave.
7. The rate of sweep shall not exceed 1.5×10^{-3} decades/s. Where the frequency is swept incrementally, the step size shall not exceed 1% of the start and thereafter 1% of the preceding frequency value.
8. Recording the EUT operating situation during compliance testing and decide the EUT immunity criterion.

- Test Results

PASS.

Please refer to the following page.




Injected Currents Susceptibility Test Results

BST Testing (Shenzhen) Co.,Ltd.

<i>Applicant</i> : NINGBO YOSUN ELECTRIC TECHNOLOGY CO., LTD		<i>Test Date</i> : Oct. 30, 2023		
<i>EUT</i> : POWER DISTRIBUTION UNIT(PDU)		<i>Temperature</i> : 22 °C		
<i>M/N</i> : YS110163-KGS		<i>Humidity</i> : 50 %		
<i>POWER DISTRIBUTION UNIT(PDU)</i> : 400V/230V~, 50/60Hz		<i>Test Mode</i> : on		
<i>Frequency Range (MHz)</i>	<i>Injected Position</i>	<i>Strength</i>	<i>Criterion</i>	<i>Result</i>
0.15 ~ 20	AC Line	3V(rms), Unmodulated	A	PASS
20 ~ 80	AC Line	3V(rms), Unmodulated	A	PASS

14) VOLTAGE DIPS AND INTERRUPTIONS TEST

- Voltage Dips and Interruptions Test Setup

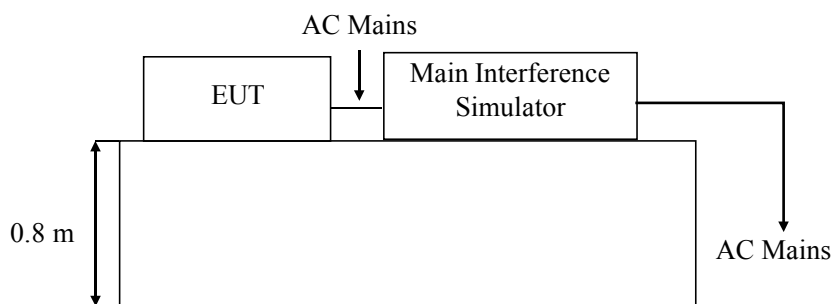

Remark: Combination wave generator and decoupling network are included in test generator.

- Test Standard

EN 55035:2017/A11:2020 (EN 61000-4-11:2004)

- Severity Levels and Performance Criterion

- Severity level

Test Level %U _T	Voltage dip and short interruptions %U _T	Durati on (in period)
0	100	250p
0	100	0.5p
70	30	25p

- Performance criterion : C & B

- EUT Configuration on Test

The configuration of EUT are listed in Section 3.2.

- Operating Condition of EUT

- Setup the EUT as shown in Section 14.1.

14.5.2. Turn on the power of all equipments.

14.5.3. Let the EUT work in test mode (On) and test it.



- Test Procedure
 1. Set up the EUT and test generator as shown on Section 14.1.
 2. The interruptions is introduced at selected phase angles with specified duration.
 3. Record any degradation of performance.
- Test Result

PASS.

Please refer to the following page.




Voltage Dips And Interruptions Test Results


BST Testing (Shenzhen) Co.,Ltd.

<i>Applicant</i>	<i>NINGBO YOSUN ELECTRIC TECHNOLOGY CO., LTD</i>			<i>Test Date</i> :	<i>Oct. 30, 2023</i>
<i>EUT</i>	<i>POWER DISTRIBUTION UNIT(PDU)</i>			<i>Temperature</i> :	<i>22 ℃</i>
<i>M/N</i>	<i>YS110163-KGS</i>			<i>Humidity</i> :	<i>50 %</i>
<i>POWER DISTRIBUTION</i>	<i>400V/230V~, 50/60Hz</i>			<i>Test Mode</i> :	<i>on</i>
<i>Test Level</i> <i>% U_T</i>	<i>Voltage Dips & Short Interruptions</i>	<i>Duration (in period)</i>	<i>Phase Angle</i>	<i>Criterion</i>	<i>Result</i>
<i>0</i>	<i>100</i>	<i>250P</i>	<i>0 ° ~360 °</i>	<i>C</i>	<i>PASS</i>
<i>40</i>	<i>60</i>	<i>5P</i>	<i>0 ° ~360 °</i>	<i>C</i>	<i>PASS</i>
<i>70</i>	<i>30</i>	<i>0.5P</i>	<i>0 ° ~360 °</i>	<i>B</i>	<i>PASS</i>




APPENDIX I

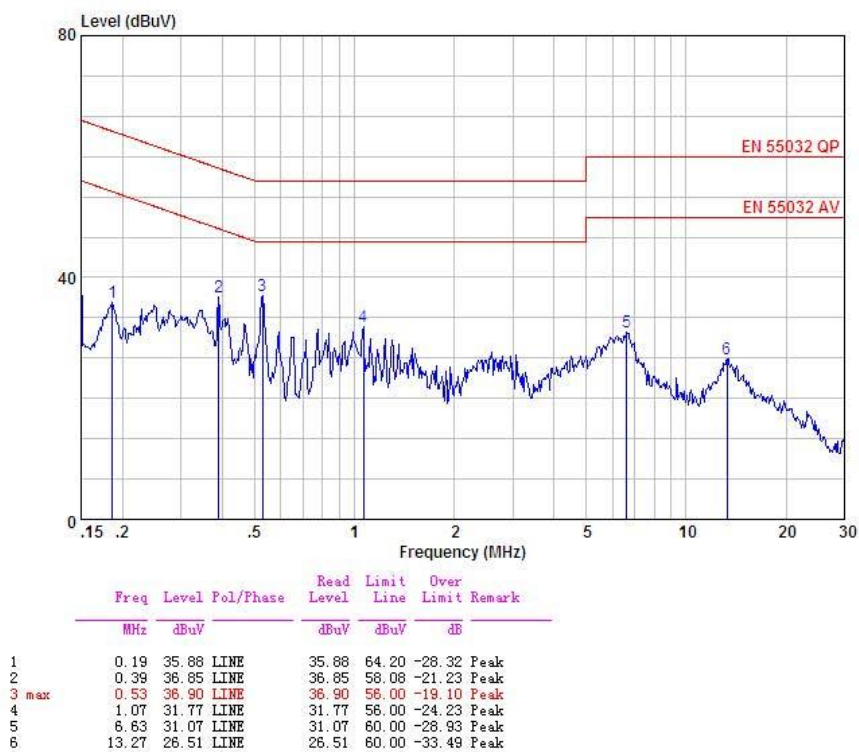

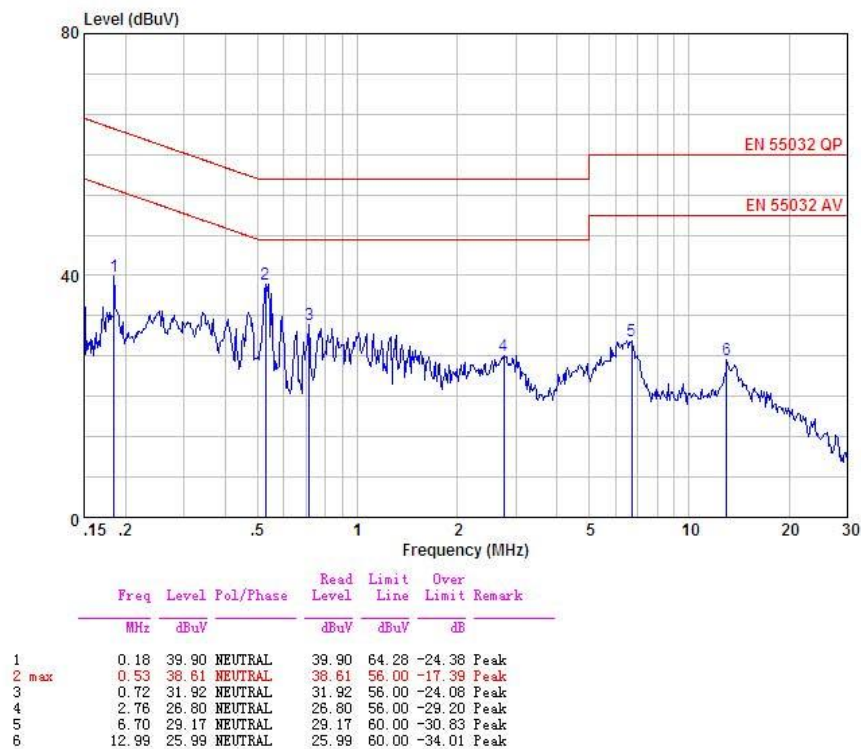



APPENDIX II

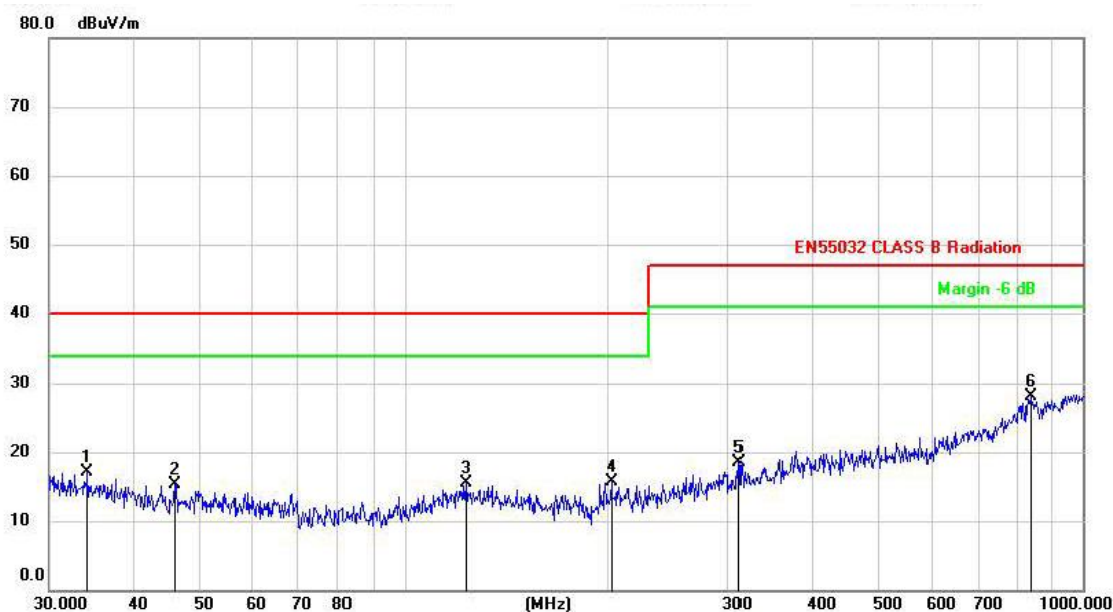

Site Chamber #1

Polarization: **Horizontal**

Temperature: 26

Limit: EN55032 CLASS B Radiation

Power:

Humidity: 55 %

EUT:


Distance: 3m

M/N:

Mode:

Note:

No.	Mk.	Freq.	Reading Level	Correct Factor	Measurement	Limit	Over	Antenna Height	Table Degree	
		MHz	dBuV	dBuV/m	dBuV/m	dBuV/m	dB	Detector	cm	degree
1		34.1561	13.18	3.95	17.13	40.00	-22.87	QP		
2		46.0164	13.60	1.62	15.22	40.00	-24.78	QP		
3		123.2655	13.10	2.37	15.47	40.00	-24.53	QP		
4		202.1005	14.22	1.50	15.72	40.00	-24.28	QP		
5		311.0867	13.73	4.75	18.48	47.00	-28.52	QP		
6	*	839.1818	14.80	13.40	28.20	47.00	-18.80	QP		

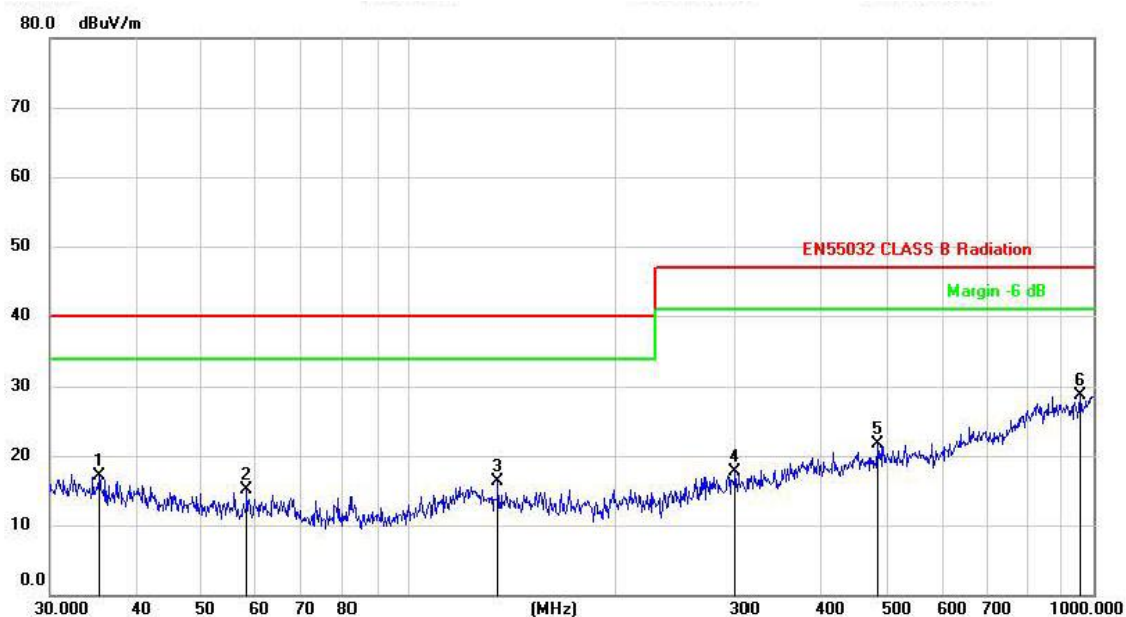

Site: Chamber #1

Polarization: **Vertical**

Temperature: 26

Limit: EN55032 CLASS B Radiation

Power:

Humidity: 55 %

EUT:

Distance: 3m

M/N:

Mode:

Note:

No.	Mk.	Freq.	Reading Level	Correct Factor	Measurement	Limit	Over	Antenna Height	Table Degree	
		MHz	dBuV	dBuV/m	dBuV/m	dBuV/m	dB	cm	degree	Comment
1		35.3750	13.37	3.80	17.17	40.00	-22.83	QP		
2		58.2030	14.40	0.64	15.04	40.00	-24.96	QP		
3		135.0319	14.53	1.75	16.28	40.00	-23.72	QP		
4		300.3672	13.23	4.41	17.64	47.00	-29.36	QP		
5		483.9094	14.30	7.31	21.61	47.00	-25.39	QP		
6	*	955.4381	14.38	14.34	28.72	47.00	-18.28	QP		



APPENDIX III

Appendix 2 Product photos

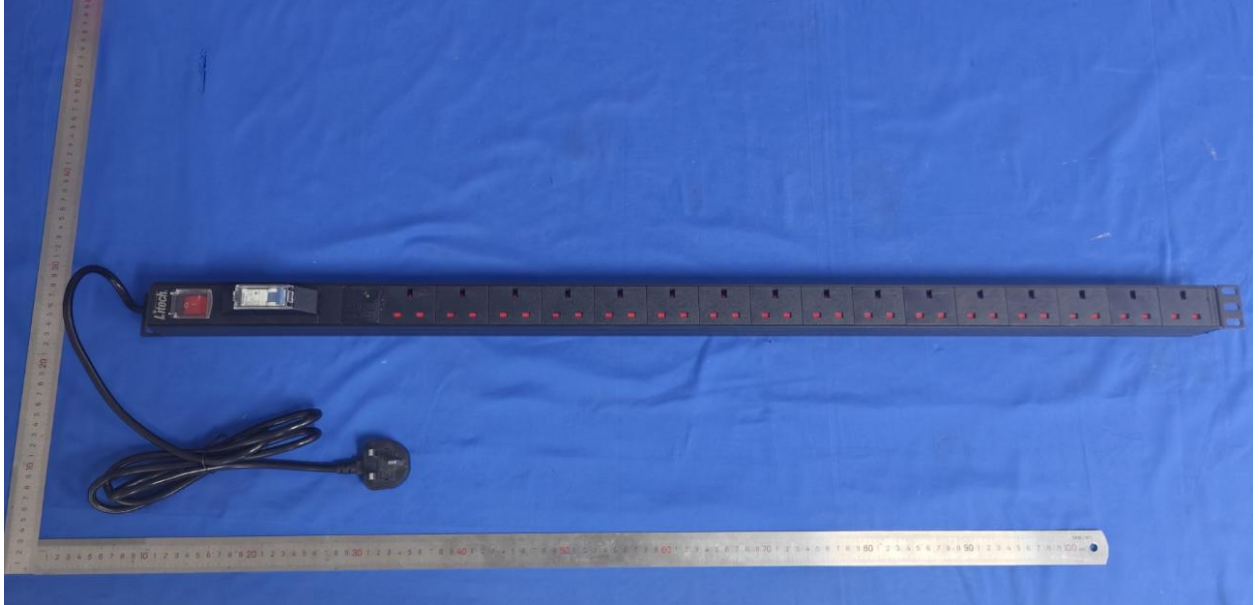


Photo 1 General Appearance of the EUT



Photo 2 General Appearance of the EUT